



2820 S. English Station Road - Louisville, KY 40299

TEST NO. 20-709-3

Test Report - Vertical Test Duct


KCI Efficiency Testing (Based on ASHRAE 52.2 Test Method)

Filter Description

Manufacturer	HIFYBER	
Filter Model	Flat Sheet Media	
Part Number	HF-SPP65-M11	
Test Area	1.0 ft ²	0.0929 m ²
Media Type	Flat Sheet Media	
Media Color	White	
Sample Procurement	HIFYBER	

Air Flow Versus Resistance

Velocity (%)	Velocity FPM / cm/s	Resistance	
		"WG	Pa
25	1.0 / 0.5	0.000	0.0
50	2.0 / 1.0	0.000	0.0
75	3.0 / 1.5	0.000	0.0
100	4.0 / 2.0	0.000	0.0
125	5.0 / 2.5	0.000	0.0
150	6.0 / 3.0	0.000	0.0

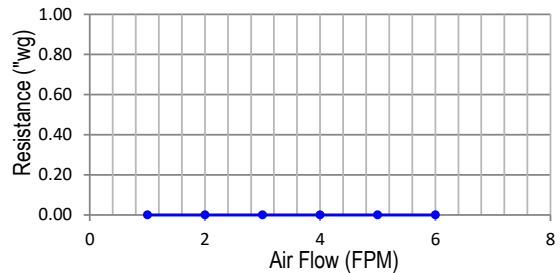

Test Conditions

Test Air Flow Rate (FPM / cm/s)	4.0 FPM	2.0 cm/s
Challenge Aerosol	Aerosolized KCI	
Counter Information	TSI 3330121001	
Test Temperature (°F / °C)	69.6 Deg F	20.9 Deg C
Relative Humidity (%)	35.1	
Barometric Pressure (\" Hg / Pa)	29.59 in. Hg	100.20 kPa

Comments: Pressure drop too low to measure


Test Results

Particle Size Range (µm)	Geo. Mean	Avg.		
0.30 - 0.40	0.346	40.02	40.02	
0.40 - 0.55	0.469	43.88	43.88	
0.55 - 0.70	0.620	47.36	47.36	E1 46
0.70 - 1.00	0.837	52.22	52.22	
1.00 - 1.30	1.140	56.38	56.38	
1.30 - 1.60	1.442	61.65	61.65	E2 65
1.60 - 2.20	1.876	67.21	67.21	
2.20 - 3.00	2.569	76.74	76.74	
3.00 - 4.00	3.464	85.36	85.36	
4.00 - 5.50	4.690	91.18	91.18	E3 92
5.50 - 7.00	6.205	95.50	95.50	
7.00 - 10.0	8.367	96.24	96.24	

Estimated MERV 11

Important Note: Please be advised that the ASHRAE committee SSPC 52.2, in March 2016, has published "addendum e" relative to the 52.2-2012 test protocol. This addendum restricts the use of the acronym "MERV" as only applicable to a test report that has been completed using the "entire procedure prescribed by the standard". This report is a modified version of the procedure and therefore, subject to that ruling. In the best interest of our customers, Blue Heaven Technologies has elected to delay this action until further assessment can be made at committee level. Where applicable, the qualified use of the term "MERV" will continue to be part of our reported data.

Efficiency vs. Particle Size

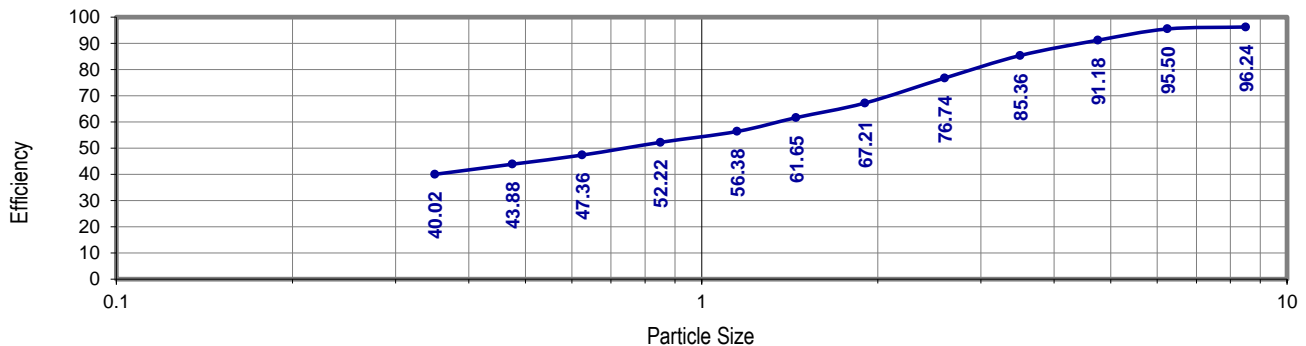

Requestor Information

Test Requestor: Mrs. Aysegul Zumbuller Fener
 Company Name: HIFYBER
 Company Address: Sumer Mah, Cal Cad No.78 Denizli, Turkey

Phone: +90 258 251 50 57
 Email: aysequf.fener@hifyber.com
 Date Requested:

Test Operator Information

Test Performed by: Evan Sparks, EIT

Completion Date: 11/16/2020